


NOTES:

1. All wiring must conform to National Electric Code, National Electrical Safety Code, as required.
2. Addition of future load should be considered when sizing meter loop.
3. Minimum wire size for:
 - 100amp meter loop, #3 copper
 - 200amp meter loop, 3/0 copper, 1/0 neutral
4. Mark neutral with white tape or stripped insulation
5. Minimum height 12' finish grade to service wire attachment in non vehicular traffic areas.
6. Meter loop not allowed on residences.
7. Meter pole, service attachment, service wire, and connectors to be furnished and installed by the coop.



FOR THE MEMBER'S SAFETY,
WIRING INSTALLATIONS SHALL
CONFORM TO THE REQUIREMENTS
OF THE NEC AND NESC.

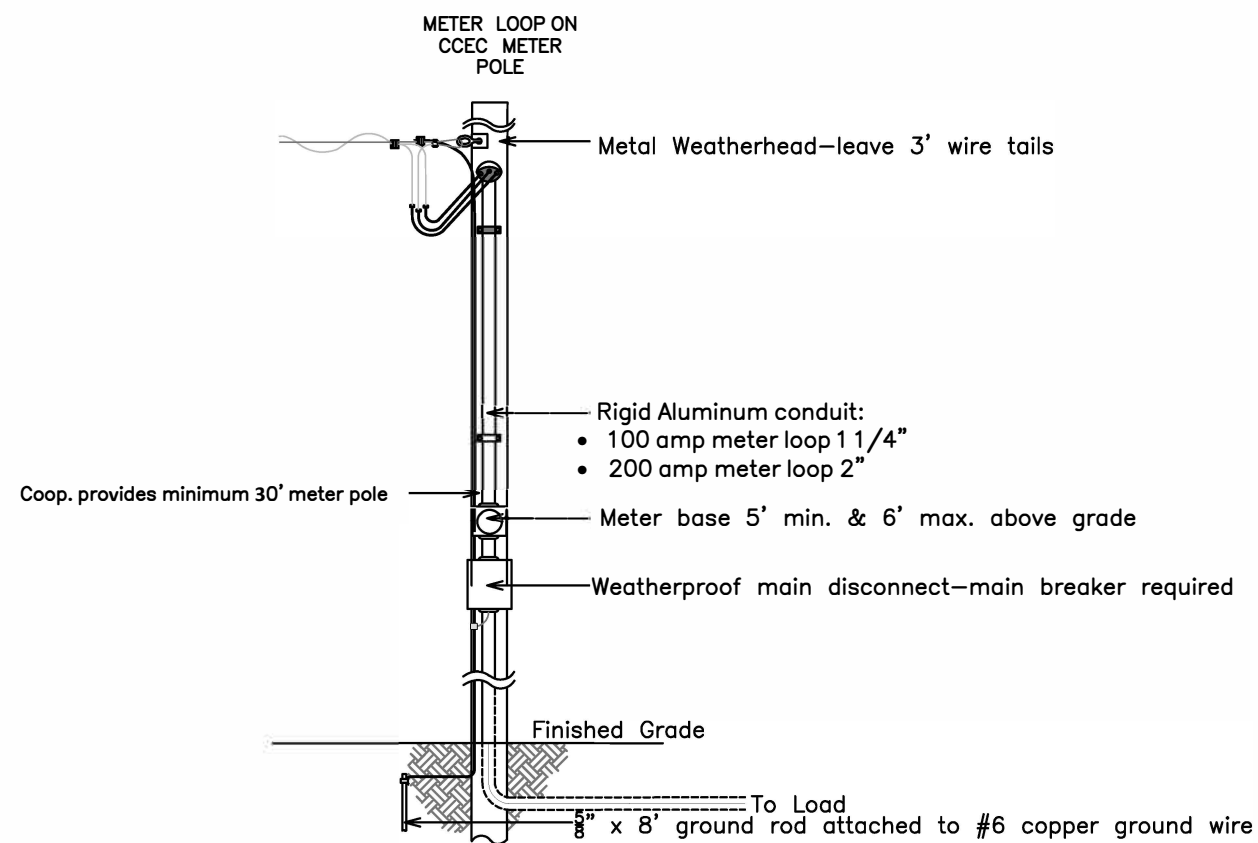

SINGLE PHASE, 200AMP SERVICE, METER
POLE WITH CLASS 200AMP METER
SOCKET

Drawn By: JH	Checked By: MG	Approved By: BM	Revised by: JH
Scale: N.T.S.	Date: 08-03-21	Drawing #:	Date: 4/19/2023