


NOTES:

1. Main disconnect panel may not be used as an electrical race way.
2. Weatherproof fittings required.
3. Two (2) disconnects can be substituted with (1) fused disconnect.
4. Notify Coleman County Electric Cooperative when meter assembly is complete.
5. Member will provide **minimum 350 copper** from meter assembly to transformer.
6. Neutral(s) may only be reduced one size on residential application. No reduction of the neutral(s) is allowed on commercial application.
7. If rack is not attached to pole, member will provide ditch and cover ditch from rack to pole.
8. Member will provide **3" rigid aluminum conduit** from pole to rack.



FOR THE MEMBER'S SAFETY,
WIRING INSTALLATIONS SHALL
CONFORM TO THE REQUIREMENTS
OF THE NEC AND NESC.

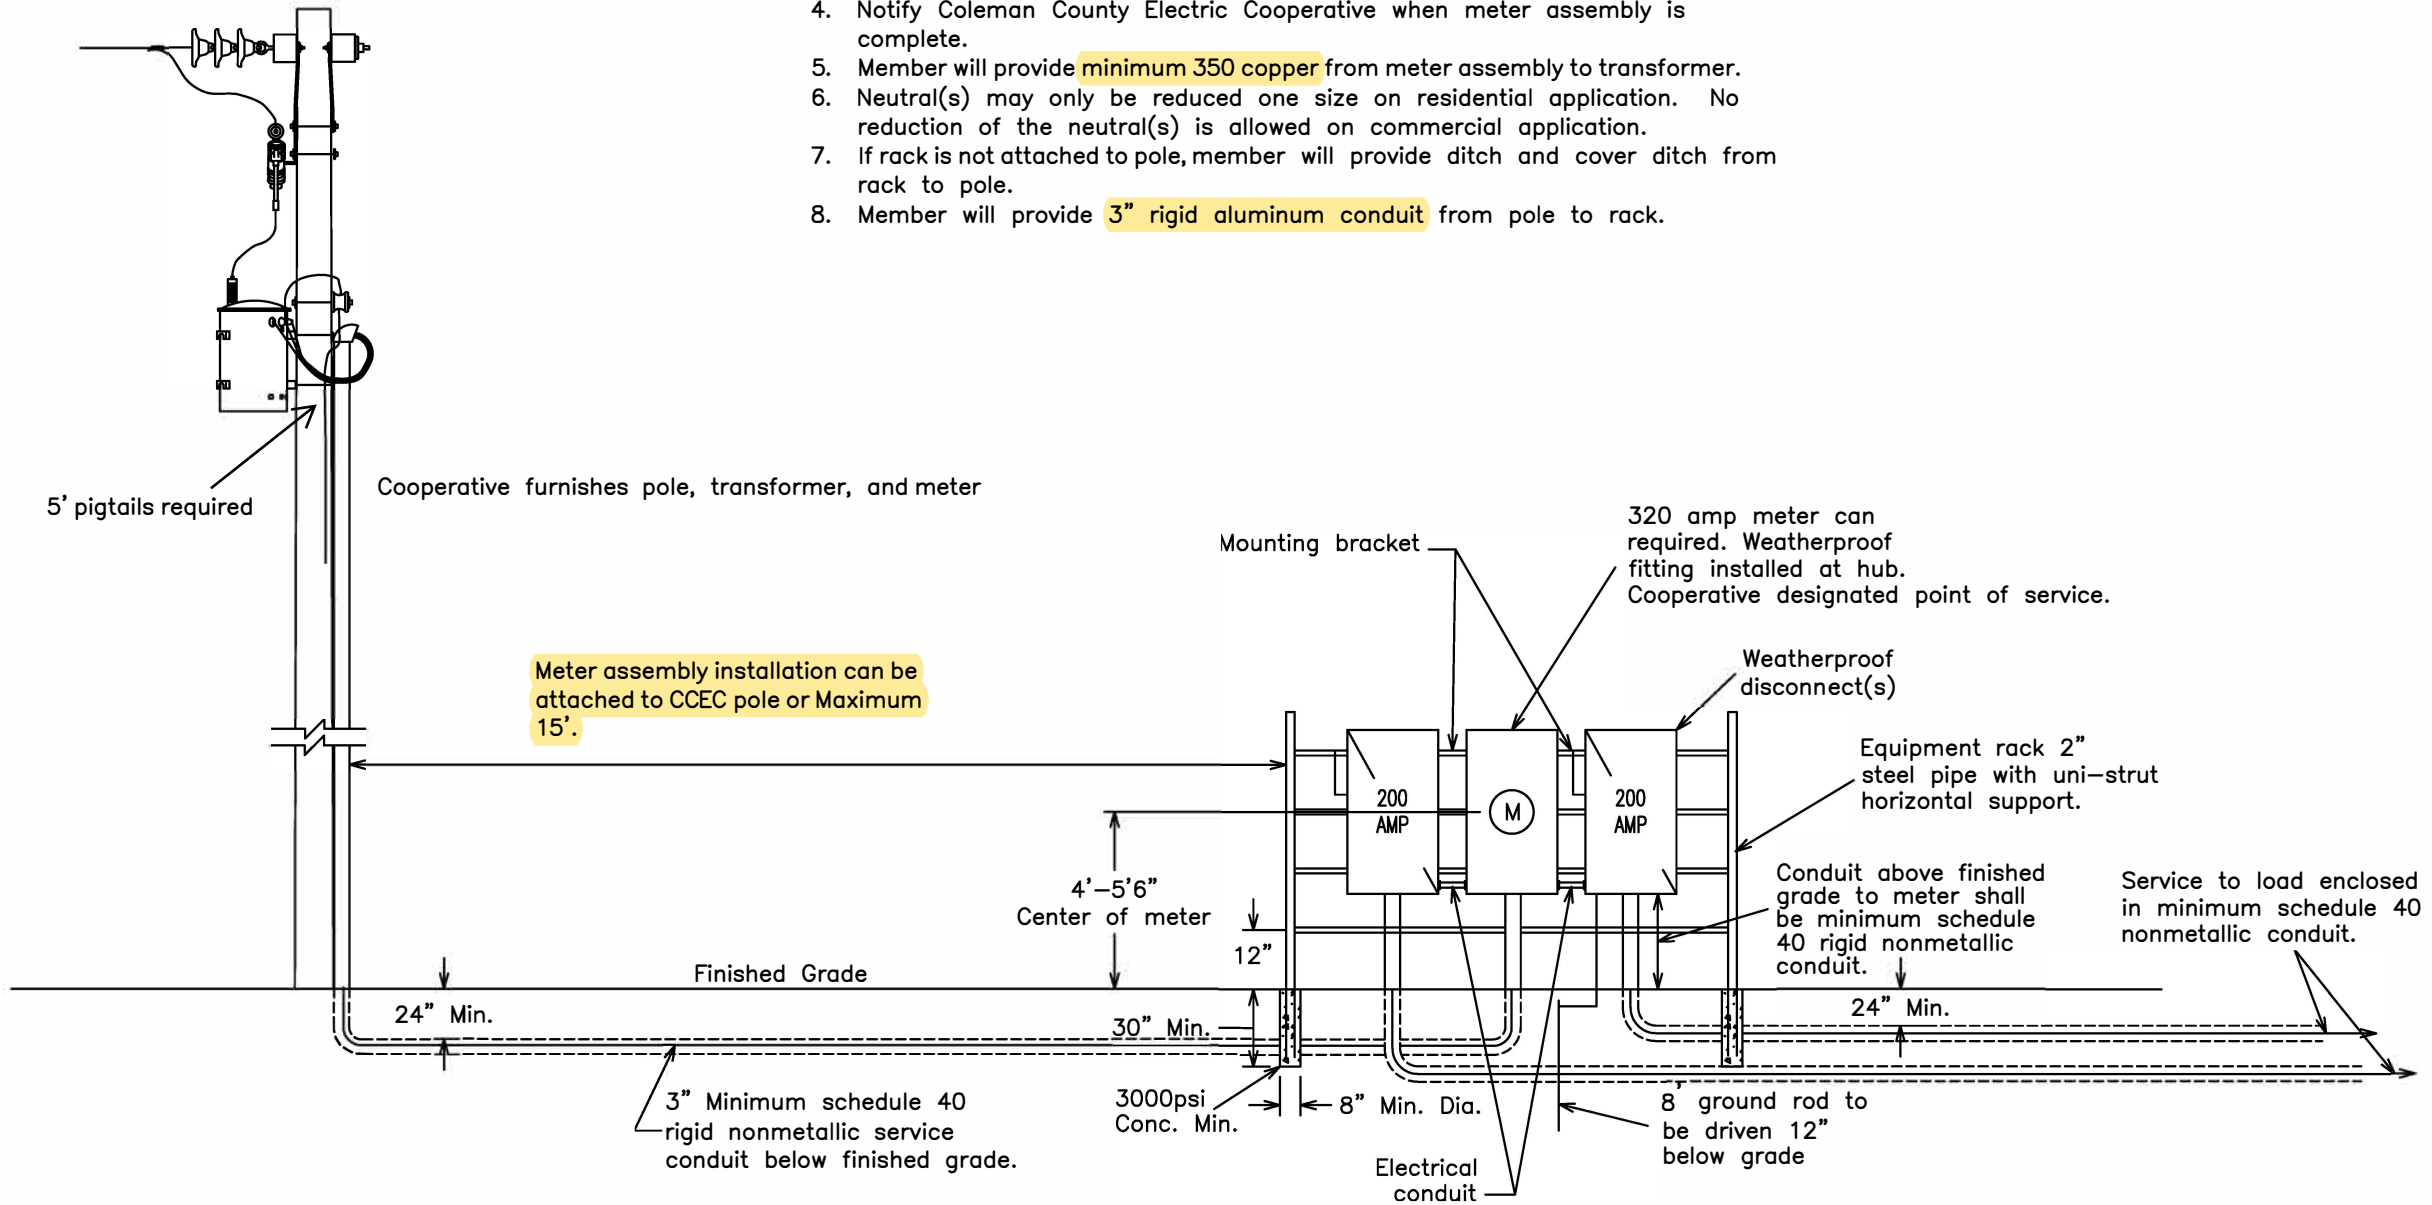

320 AMP URD SERVICE ON RACK
FROM OVERHEAD WITH CLASS 320
METER SOCKET, 1 OR 2 DISCONNECTS

Drawn By: JH		Approved By:	Revised JH
Scale: N.T.S.	Date: 09-10-21	Drawing #:	Date: 04/19/23